



CITY OF SANTA CLARITA


BUILDING & SAFETY DIVISION

23920 Valencia Boulevard, Suite 140

Santa Clarita, CA 91355 (661) 255-4935

Residential Attic Furnaces Plan Requirements

Residential warm-air furnaces (forced air units) installed in attics shall comply with the following requirements.

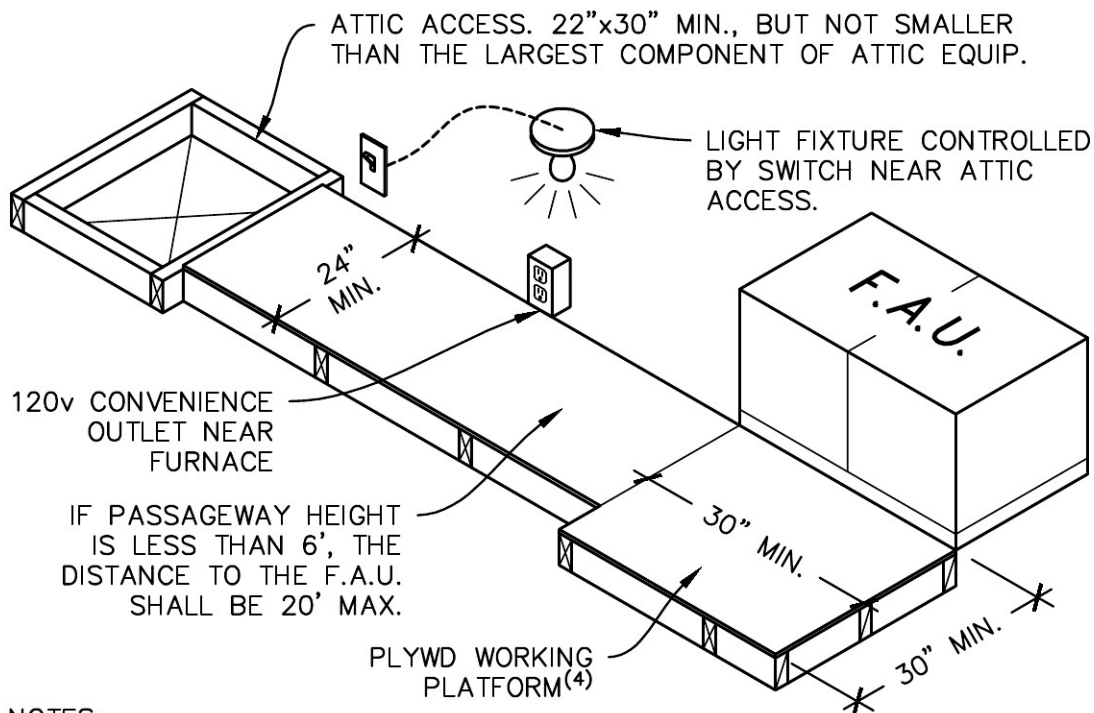

NOTES:

1. REQUIREMENTS PER CA MECHANICAL CODE SEC. 304.0.
2. FURNACE (F.A.U.) SHALL BE LISTED FOR THE USE SHOWN.
3. MAINTAIN ALL CLEARANCES AS SPECIFIED IN THE F.A.U. LISTING REPORT.
4. A WORKING PLATFORM NEED NOT BE PROVIDED WHERE THE FURNACE IS CAPABLE OF BEING SERVICED FROM THE REQUIRED ACCESS OPENING AND THE SERVICE SIDE DOES NOT EXCEED 12" FROM THE OPENING.
5. PROVIDE A DISCONNECTING MEANS WITHIN SIGHT AND READILY ACCESSIBLE FROM THE FURNACE PER CA ELECTRICAL CODE.